

94

83

94

BELFORD

BRYANT

ALCOTT

ALCOTT

TERRACE CT.

BANK

REED

BELFORD

BRYANT PAPER CO.

ONE HUNDRED & SIXTY-SEVEN BRYANT STREET IN OFFICE
(STATIONS & MACHINERY) ALSO MILLWORKS AT FERRY
ROADS; MANUFACTURES AUTO SPRINKLERS (NET SYSTEM)
SOURCE OF SUPPLY CITY DIRECT & UNDERWRITERS PUMP WORK
DRIVE FROM MILL POND ARE: CITY (NETWORK) A CITY
AND UNDERWRITERS PUMP WORK FROM MILL POND
P.M. 30 INCH. CITY PRESSURE 30 PSI. AND WOULD WORK
AUTOMATICALLY IF PUMP PRESSURE WOULD BE LOW
SPRINKLER HEADS SPACED 6' x 6' AND ARE IN ALL BUILTS
EXCEPT ON A LINE AND A BRANCH - 100' IN DIAMETER
ONE 1/2" PIPE IN DOWN HILL - 3/4" 2" PIPE TO BURN IN
PILLS OF WATER IN ALL DEPARTMENTS - BARRIERS OF WATER
IN BUILT ROOMS & ARE A PAPER STORAGE DEPARTMENT
FUEL: COAL, HEAT: STEAM, LIGHTS: ELECTRIC (OWN PLANT)
2 DOZEN CENTRAL EXTRACTORS, NEW BUILDINGS
HAVE NO NUMBERS.

SUPERIOR PAPER CO.

NIGHT & SUNDAY WATCHMAN, NEWBORN CLOCK IS STARTING
MONEY RECEIVED, STEAM IS NOT COMPARED TO FUEL COAL
NEXT: LIGHTS: ELECTRIC, PUMP WATER
MANUFACTURES AUTO SPRINKLERS THROUGH (NET SYSTEM)
SUPPLIED BY CITY WATER & UNDERWRITERS PUMP WORK
FROM MILL POND (PUMP 18" X 18" X 12") CAPACITY 1000 GALS
P.M. 30 INCH. CITY PRESSURE 30 PSI. AND WOULD WORK
AUTOMATICALLY IF PUMP PRESSURE WOULD BE LOW
SPRINKLER HEADS SPACED 6' x 6' AND ARE IN ALL BUILTS
EXCEPT ON A LINE AND A BRANCH - 100' IN DIAMETER
ONE 1/2" PIPE IN DOWN HILL - 3/4" 2" PIPE TO BURN IN
PILLS OF WATER IN ALL DEPARTMENTS - BARRIERS OF WATER
IN BUILT ROOMS & ARE A PAPER STORAGE DEPARTMENT
FUEL: COAL, HEAT: STEAM, LIGHTS: ELECTRIC (OWN PLANT)
2 DOZEN CENTRAL EXTRACTORS, NEW BUILDINGS
HAVE NO NUMBERS.

Mill Pond

ILLINOIS ENVELOPE CO.



NIGHT & SUNDAY WATCHMAN, NEWBORN CLOCK IS STARTING
MONEY RECEIVED, STEAM IS NOT COMPARED TO FUEL COAL
NEXT: LIGHTS: ELECTRIC, PUMP WATER
MANUFACTURES AUTO SPRINKLERS THROUGH (NET SYSTEM)
SUPPLIED BY CITY WATER & UNDERWRITERS PUMP WORK
FROM MILL POND (PUMP 18" X 18" X 12") CAPACITY 1000 GALS
P.M. 30 INCH. CITY PRESSURE 30 PSI. AND WOULD WORK
AUTOMATICALLY IF PUMP PRESSURE WOULD BE LOW
SPRINKLER HEADS SPACED 6' x 6' AND ARE IN ALL BUILTS
EXCEPT ON A LINE AND A BRANCH - 100' IN DIAMETER
ONE 1/2" PIPE IN DOWN HILL - 3/4" 2" PIPE TO BURN IN
PILLS OF WATER IN ALL DEPARTMENTS - BARRIERS OF WATER
IN BUILT ROOMS & ARE A PAPER STORAGE DEPARTMENT
FUEL: COAL, HEAT: STEAM, LIGHTS: ELECTRIC (OWN PLANT)
2 DOZEN CENTRAL EXTRACTORS, NEW BUILDINGS
HAVE NO NUMBERS.

IMPERIAL COATING MILLS

ONE HUNDRED & SIXTY-SEVEN BRYANT STREET IN OFFICE
(STATIONS & MACHINERY) ALSO MILLWORKS AT FERRY
ROADS; MANUFACTURES AUTO SPRINKLERS (NET SYSTEM)
SOURCE OF SUPPLY CITY DIRECT & UNDERWRITERS PUMP WORK
DRIVE FROM MILL POND ARE: CITY (NETWORK) A CITY
AND UNDERWRITERS PUMP WORK FROM MILL POND
P.M. 30 INCH. CITY PRESSURE 30 PSI. AND WOULD WORK
AUTOMATICALLY IF PUMP PRESSURE WOULD BE LOW
SPRINKLER HEADS SPACED 6' x 6' AND ARE IN ALL BUILTS
EXCEPT ON A LINE AND A BRANCH - 100' IN DIAMETER
ONE 1/2" PIPE IN DOWN HILL - 3/4" 2" PIPE TO BURN IN
PILLS OF WATER IN ALL DEPARTMENTS - BARRIERS OF WATER
IN BUILT ROOMS & ARE A PAPER STORAGE DEPARTMENT
FUEL: COAL, HEAT: STEAM, LIGHTS: ELECTRIC (OWN PLANT)
2 DOZEN CENTRAL EXTRACTORS, NEW BUILDINGS
HAVE NO NUMBERS.

In case of pumps failing to work in the Imperial Coating Mills,
Bryant Paper Co. or Superior Paper Co. pressure could be had
from either of the other two plants not equipped, by valves opening
automatically. All three systems are connected, and pressure
at the plants fall below 30 lbs City pressure would work automatically.

IMPERIAL COATING MILLS
COATING 10 & 20
MFG. SURFACE COATED & LITHOGRAPHIC PAPERS ETC.
STEEL TRUSS ROOF.

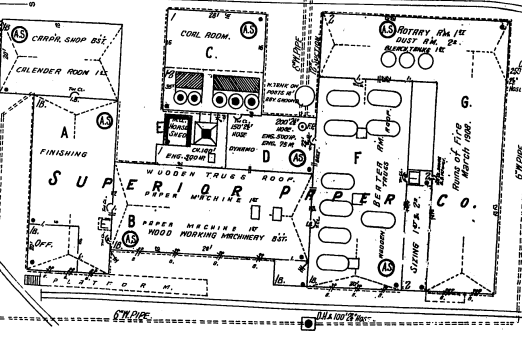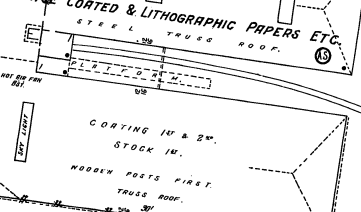

Scale of Feet. 50 100 150